


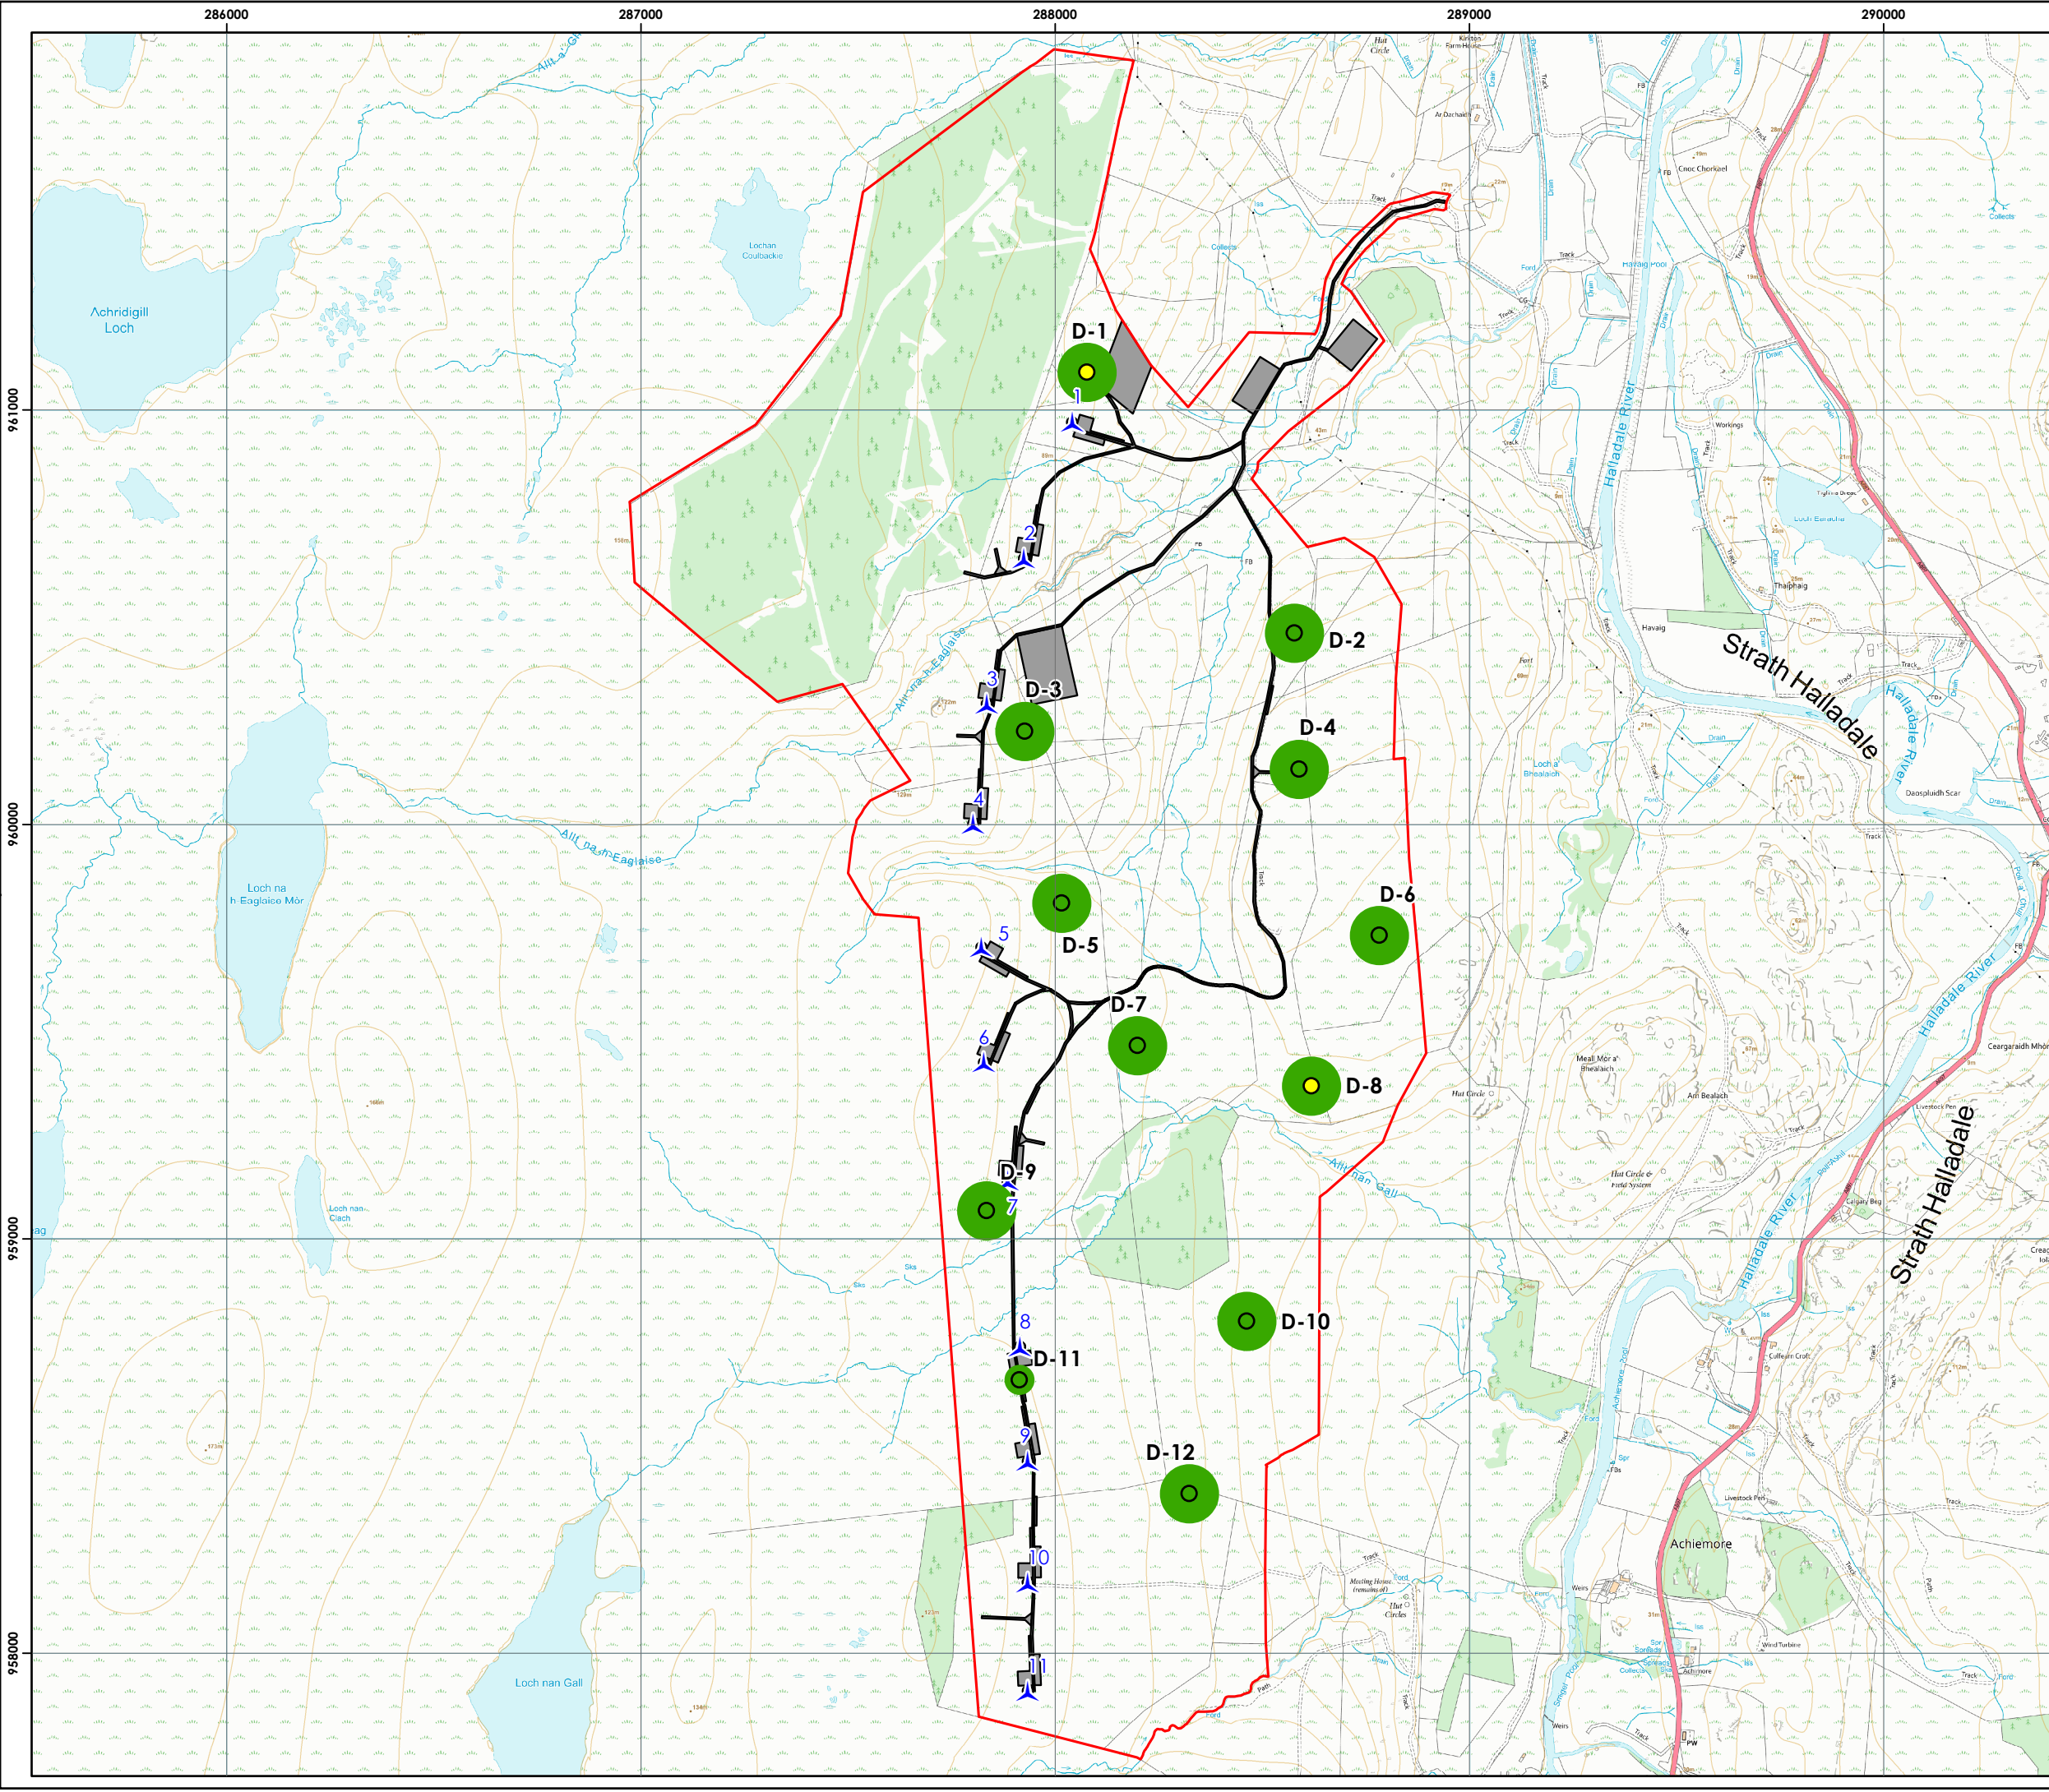

Kirkton Energy Park

Kirkton Wind Farm Ltd

SEI Figure 8.2.3c
Bat Activity Survey Results
Autumn

Key

- Site boundary
- Proposed turbine
- Proposed infrastructure

Bat passes per hour

- < 0.05
- 0.05 - 0.20
- > 0.20

Median pass rate per hour

- < 1
- 1 - 2
- > 2



0 125 250 500
Metres

Scale @ A3:
1:15,000

N

© Crown copyright 2023. All rights reserved.
Ordnance survey licence number 100031673.